


## External Dimensions

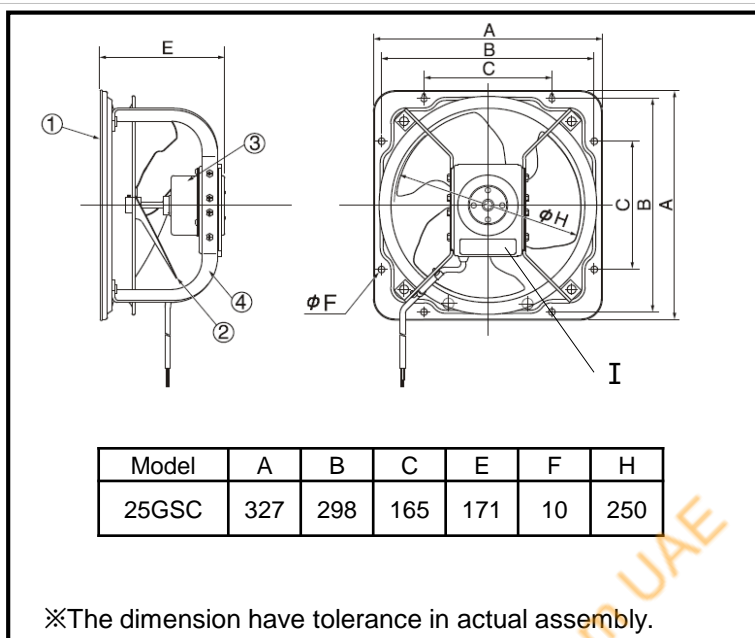

Unit: mm

### Labeling Position

Mark	Item	Comment
I	NAME PLATE	-

## Component Parts List

### Main Parts List

Mark	Part Name	Material	Quantity
①	Frame	Metal	1
②	Blade	Metal	1
③	Motor	Metal	-
④	Motor Support	Metal	4

### Accessory List



Item	Quantity	comment
Operating instruction	1	-

## Authentication Information

认证种类 (测试机构等) IEC (TUV)

Product		Page		1/5	
Ventilating Fan		Model		25GSC	
Make Date	2022.03.09	Scale	Drawing No.	HPVF22002	
Modification Date			Modification No.		
KDK Company, Division of PES					

## Specification Data (25GSC 220~240V 50Hz)

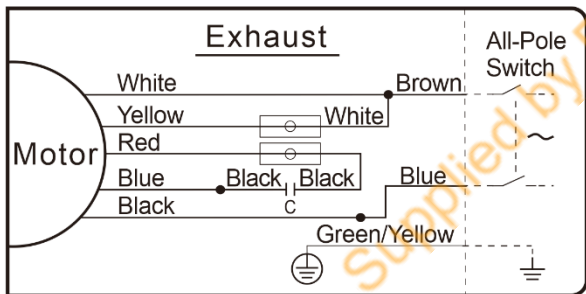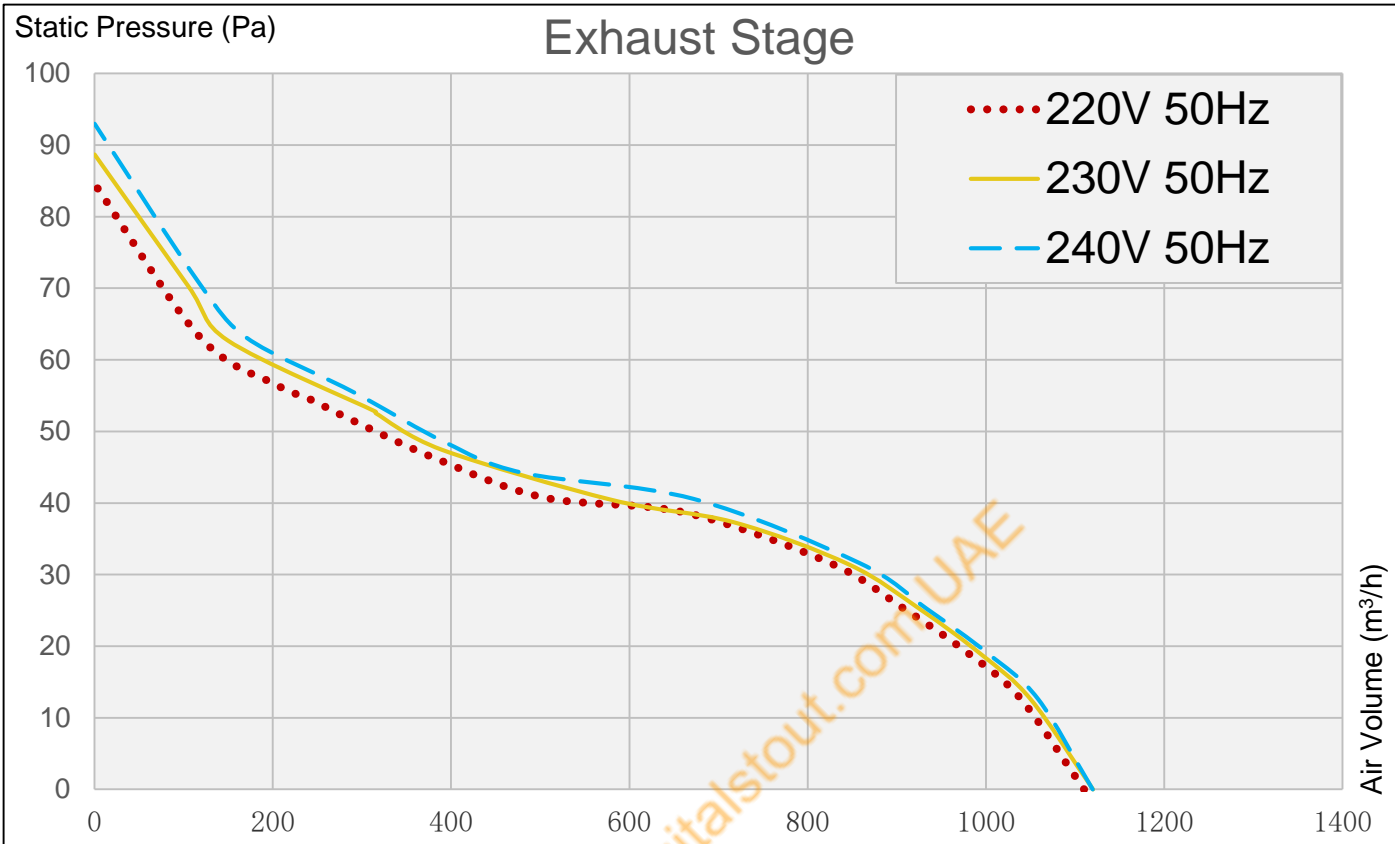

MODEL	25GSC		
	Exhaust Stage		
Rated Voltage (V)	220	230	240
Rated Frequency (Hz)	50	50	50
Power Consumption (W)	39	41.5	44
Air Volume (m³/h)	1100	1120	1120
Noise (dB)	34.2	34.2	34.3
Net Weight (Kg)	4.4		
Motor Type	AC Motor (Class E)		
Ventilation Hole Size	275mm*275mm		



■ Air volume, electric specification and noise value are measured when static pressure is 0 Pa.

■ Noise value is the weighted sound pressure grade A, which is the central value measured by this company, its tolerance range is from +3 to -7. The method to measure is as follows: in an anechoic chamber, measure noise value first 1m away from the left, right and center of the sample, then get the averaged value.

■ Air volume is the central value measured by this company with  $\pm 10\%$  of tolerance range.

Product		Page		2/5	
Ventilating Fan		Model			
		25GSC			
Make Date	2022.03.09	Scale	Drawing No.	HPVF22002	
Modification Date			Modification No.		
KDK Company, Division of PES					

## ■ Specification Data (25GSC 220~230V 60Hz)

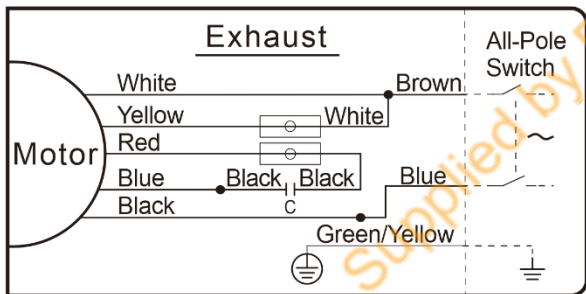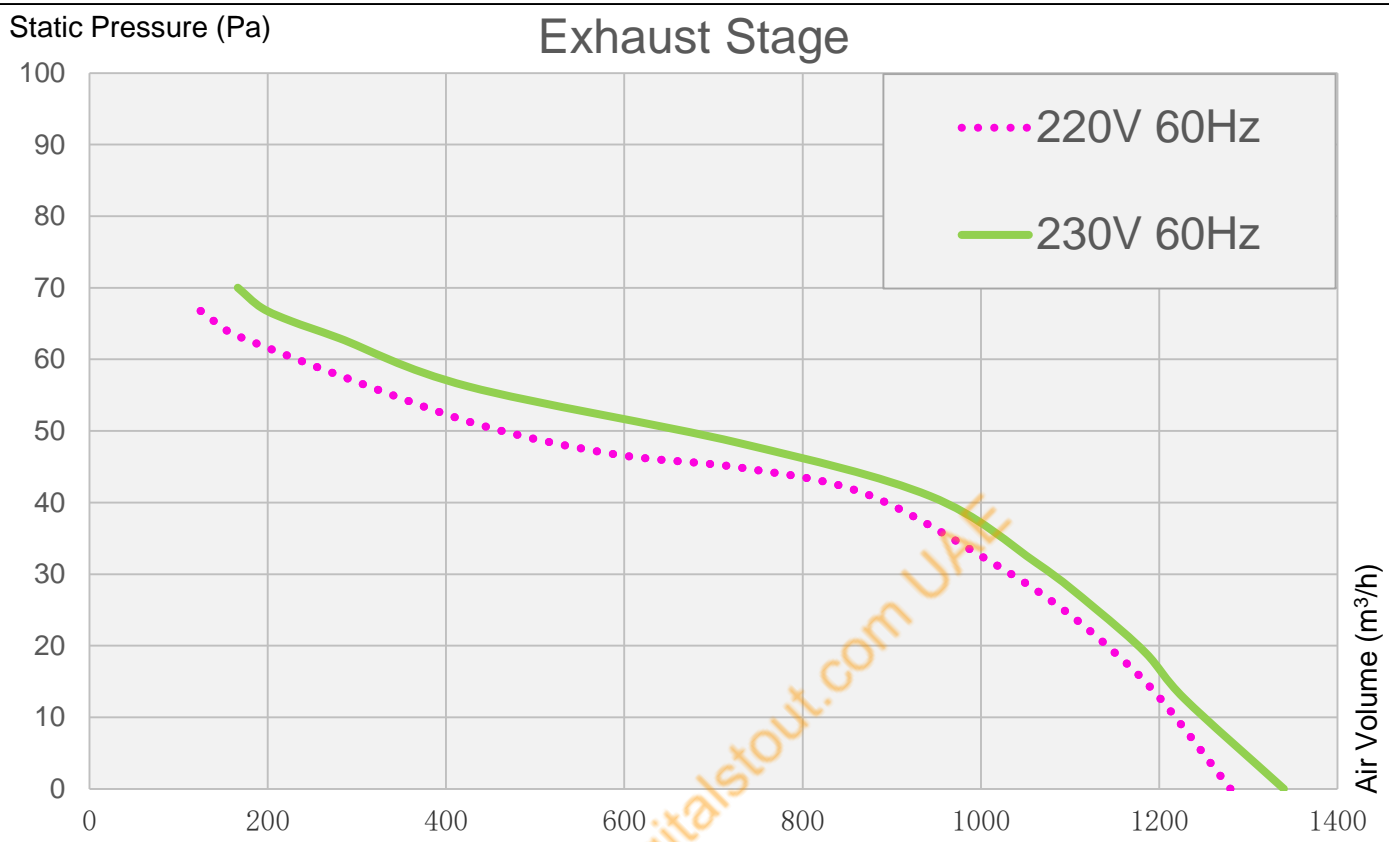

MODEL	25GSC	
	Exhaust Stage	
Rated Voltage (V)	220	230
Rated Frequency (Hz)	60	60
Power Consumption (W)	47	50
Air Volume (m <sup>3</sup> /h)	1280	1340
Noise (dB)	38.7	38.9
Net Weight (Kg)	4.4	
Motor Type	AC Motor (Class E)	
Ventilation Hole Size	275mm*275mm	



■ Air volume, electric specification and noise value are measured when static pressure is 0 Pa.

■ Noise value is the weighted sound pressure grade A, which is the central value measured by this company, its tolerance range is from +3 to -7. The method to measure is as follows: in an anechoic chamber, measure noise value first 1m away from the left, right and center of the sample, then get the averaged value.

■ Air volume is the central value measured by this company with  $\pm 10\%$  of tolerance range.

Product			Page	3/5
Ventilating Fan			Model	
			25GSC	
Make Date	2022.03.09	Scale	Drawing No.	HPVF22002
Modification Date			Modification No.	
KDK Company, Division of PES				

## ■ Specification Data (25GSC 110~127V 50Hz)

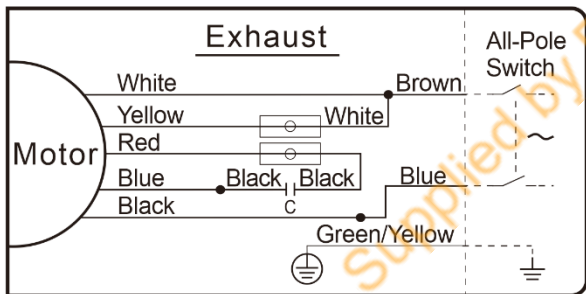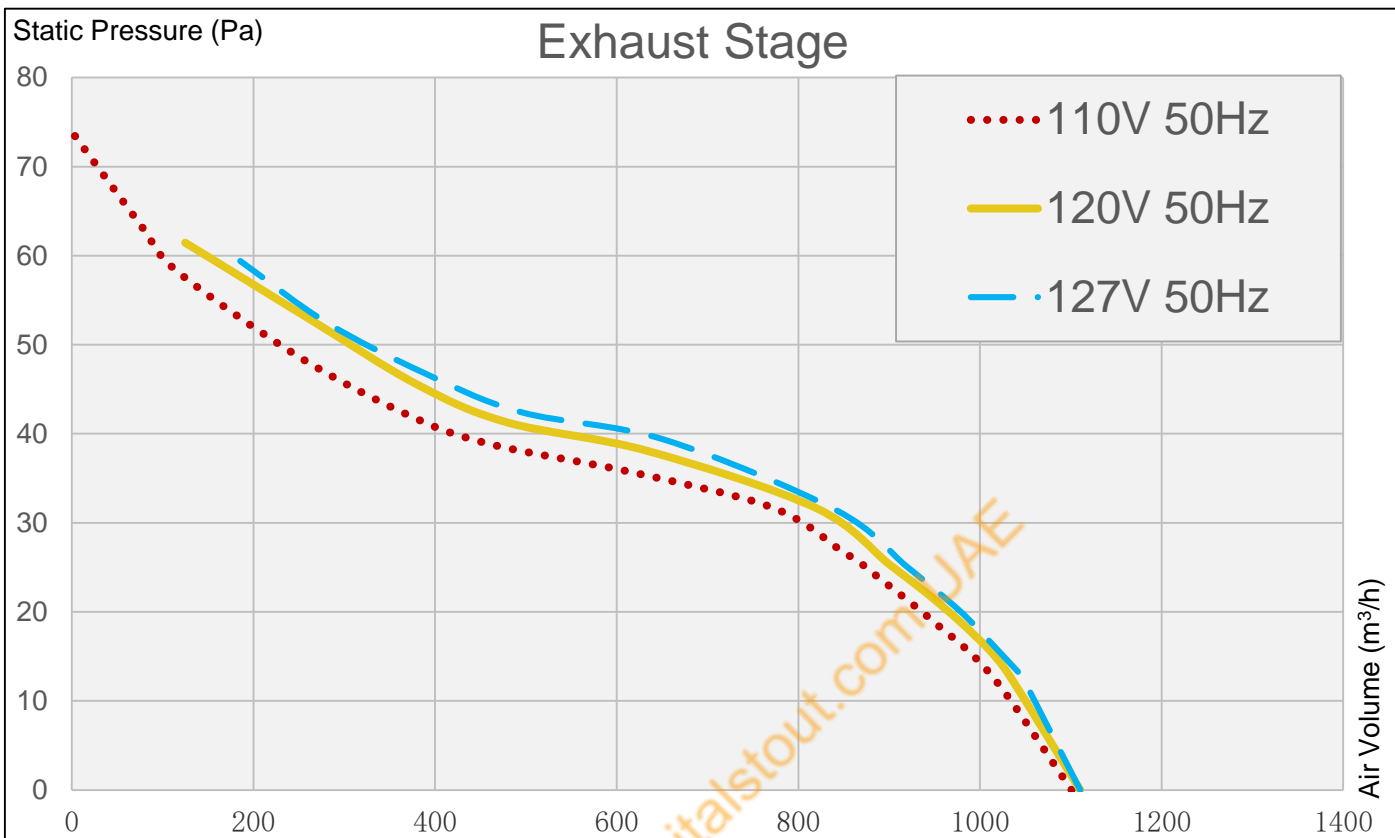

MODEL	25GSC		
	Exhaust Stage		
Rated Voltage (V)	110	120	127
Rated Frequency (Hz)	50	50	50
Power Consumption (W)	37.5	41.5	45.5
Air Volume (m³/h)	1100	1110	1110
Noise (dB)	34	34.2	34.2
Net Weight (Kg)	4.4		
Motor Type	AC Motor (Class E)		
Ventilation Hole Size	275mm*275mm		



■ Air volume, electric specification and noise value are measured when static pressure is 0 Pa.

■ Noise value is the weighted sound pressure grade A, which is the central value measured by this company, its tolerance range is from +3 to -7. The method to measure is as follows: in an anechoic chamber, measure noise value first 1m away from the left, right and center of the sample, then get the averaged value.

■ Air volume is the central value measured by this company with  $\pm 10\%$  of tolerance range.

Product		Page	
Ventilating Fan		4/5	
Model		25GSC	
Make Date	2022.03.09	Scale	Drawing No. HPVF22002
Modification Date			Modification No.
KDK Company, Division of PES			

## Specification Data (25GSC 110~127V 60Hz)

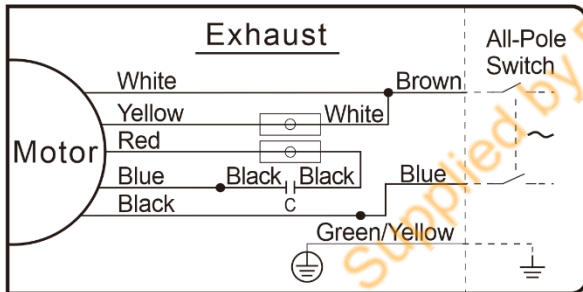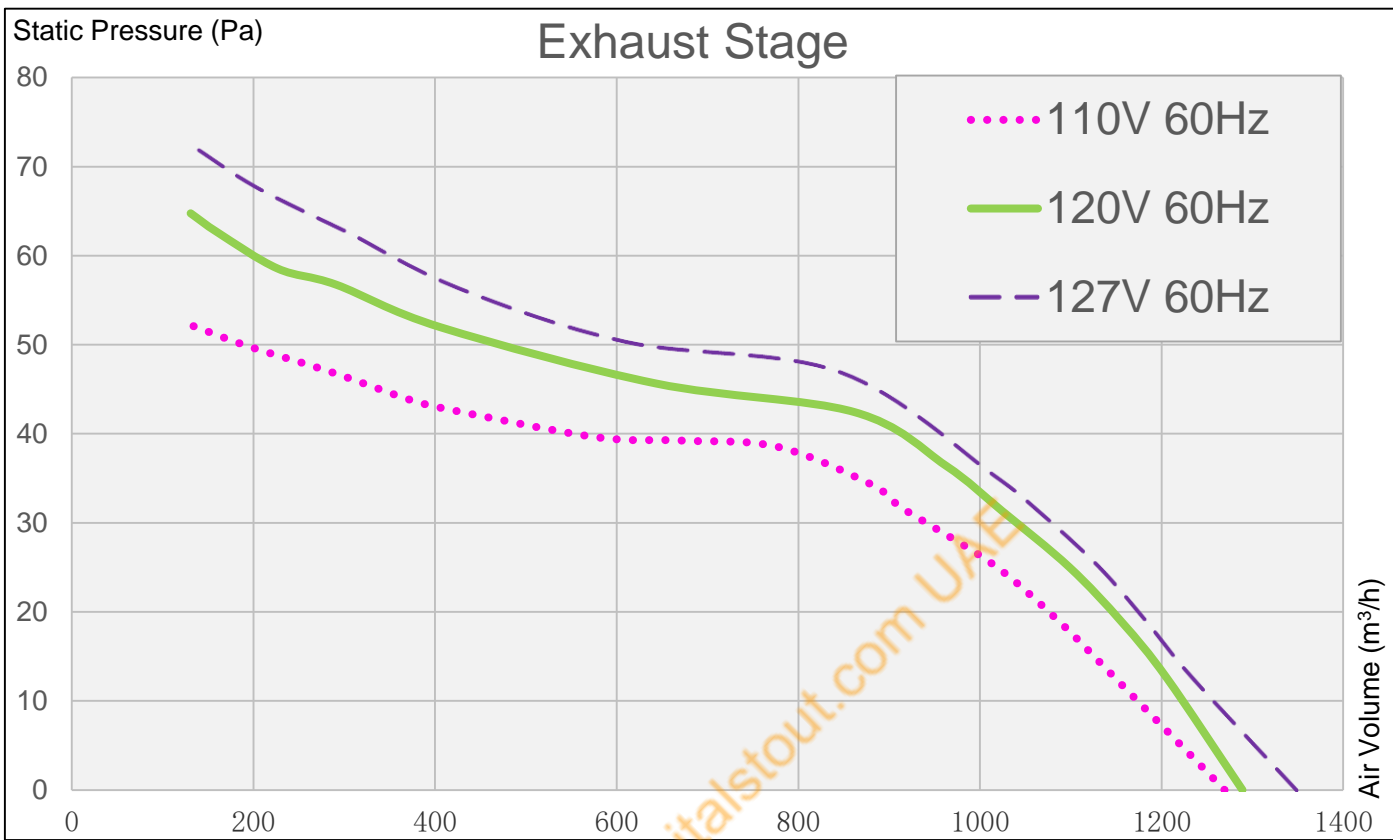

MODEL	25GSC		
	Exhaust Stage		
Rated Voltage (V)	110	120	127
Rated Frequency (Hz)	60	60	60
Power Consumption (W)	45	48	51
Air Volume (m³/h)	1270	1290	1350
Noise (dB)	37.9	38.2	38.2
Net Weight (Kg)	4.4		
Motor Type	AC Motor (Class E)		
Ventilation Hole Size	275mm*275mm		

■ Air volume, electric specification and noise value are measured when static pressure is 0 Pa.

■ Noise value is the weighted sound pressure grade A, which is the central value measured by this company, its tolerance range is from +3 to -7. The method to measure is as follows: in an anechoic chamber, measure noise value first 1m away from the left, right and center of the sample, then get the averaged value.

■ Air volume is the central value measured by this company with ±10% of tolerance range.

Product		Page		5/5	
Ventilating Fan		Model		25GSC	
Make Date	2022.03.09	Scale	Drawing No.	HPVF22002	
Modification Date			Modification No.		
KDK Company, Division of PES					